



3421.**
RING TERMINALS · WITH INSULATION SUPPORT



Specification 9.5 mm Plate

Ø (mm) 5,2

Wire size mm² (AWG) 0,5-2,5 (20-14)

Ø Insulation (mm) 1,8-4,3

Materials, temperature and contact resistance

Part nr.	Material	Finishing	Max. Temp. (°C)
3421.00	Brass	Natural	110
3421.02	Brass	Tin plated	120
3421.30	Bronze	Natural	120
3421.32	Bronze	Tin plated	130

Material thickness (mm) 0,8


Max. rated current

Wire section	3421.00 / 02 / 30 / 32
0.50 mm ²	8A
0.75 mm ²	10A
1.00 mm ²	12A
1.50 mm ²	16A
2.50 mm ²	20A

Application tool MN3420

Wire strip length 6.0 (±0.5) mm

Crimping parameters & pull out force

Wire section (±10%)	Conductor 		Insulator	Pull-out force (N)
	Height (mm)	Width (mm)	Width (mm)	
0.50 mm ²	2.15 (±0.03)	4.06 (±0.03)	4.50 (±0.10)	60N
0.75 mm ²	2.20 (±0.05)	4.07 (±0.05)	4.50 (±0.10)	85N
1.00 mm ²	2.25 (±0.05)	4.07 (±0.05)	4.50 (±0.10)	108N
1.50 mm ²	2.35 (±0.05)	4.07 (±0.05)	4.50 (±0.10)	150N
2.00 mm ²	2.45 (±0.05)	4.10 (±0.05)	4.50 (±0.10)	200N
2.50 mm ²	2.50 (±0.05)	4.10 (±0.05)	4.50 (±0.10)	230N

Values only valid for the application tool specified upwards. The insulator widths are only indicative as they are dependent on the sheath thickness of the wire used.

Winding number 6000

Approvals






3421.**
RING TERMINALS · WITH INSULATION SUPPORT



Drawing

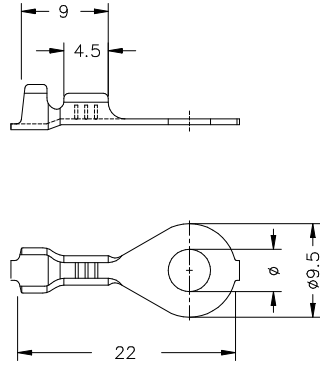




3421.00 NATURAL BRASS


RING TERMINALS · WITH INSULATION SUPPORT



Derating curve Current carrying capacity vs. Ambient temperature

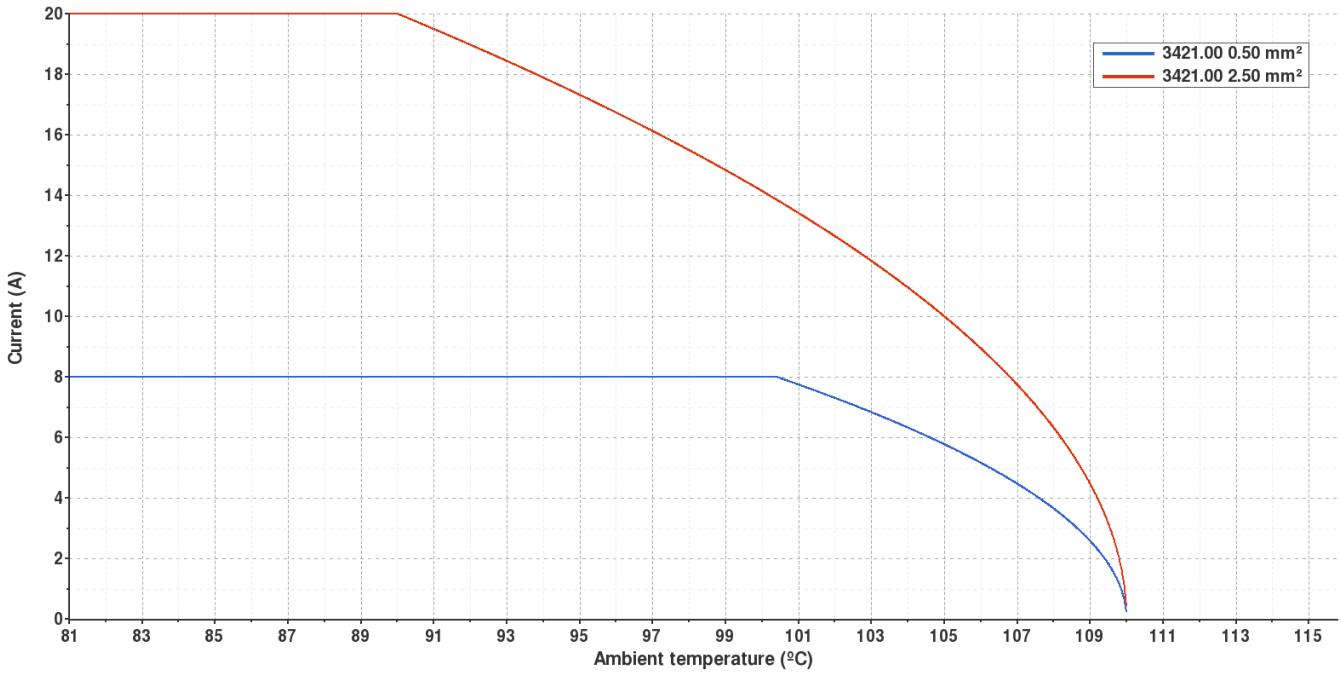

Temperature rise curve Terminal temperature rise due to the current carried

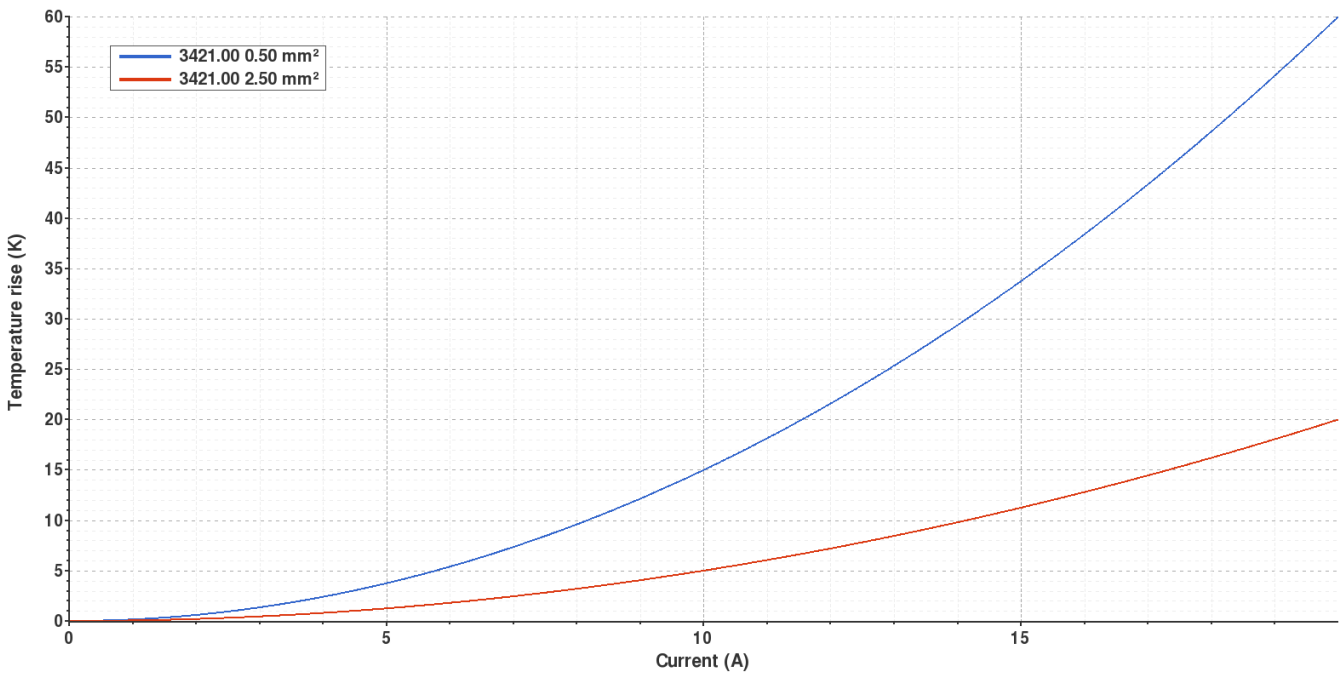


Valid for 3421.00 - M5




3421.02 TIN PLATED BRASS
RING TERMINALS · WITH INSULATION SUPPORT



Derating curve Current carrying capacity vs. Ambient temperature

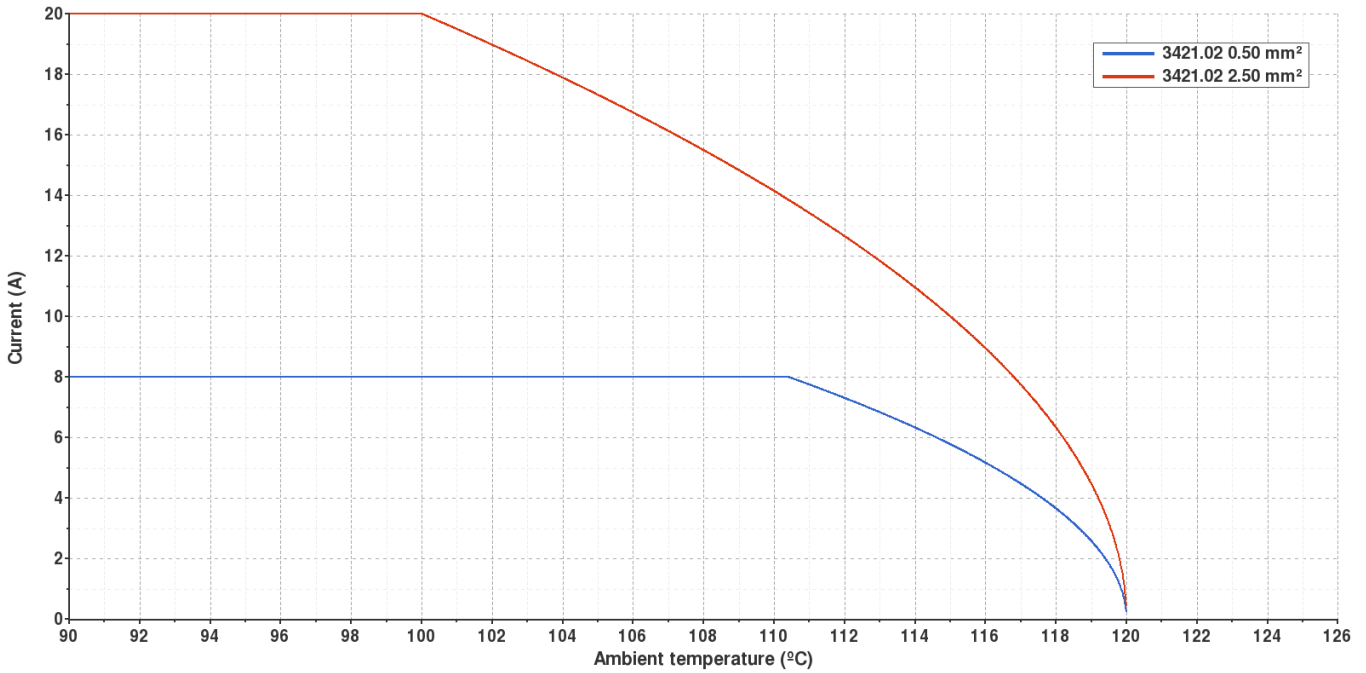

Temperature rise curve Terminal temperature rise due to the current carried

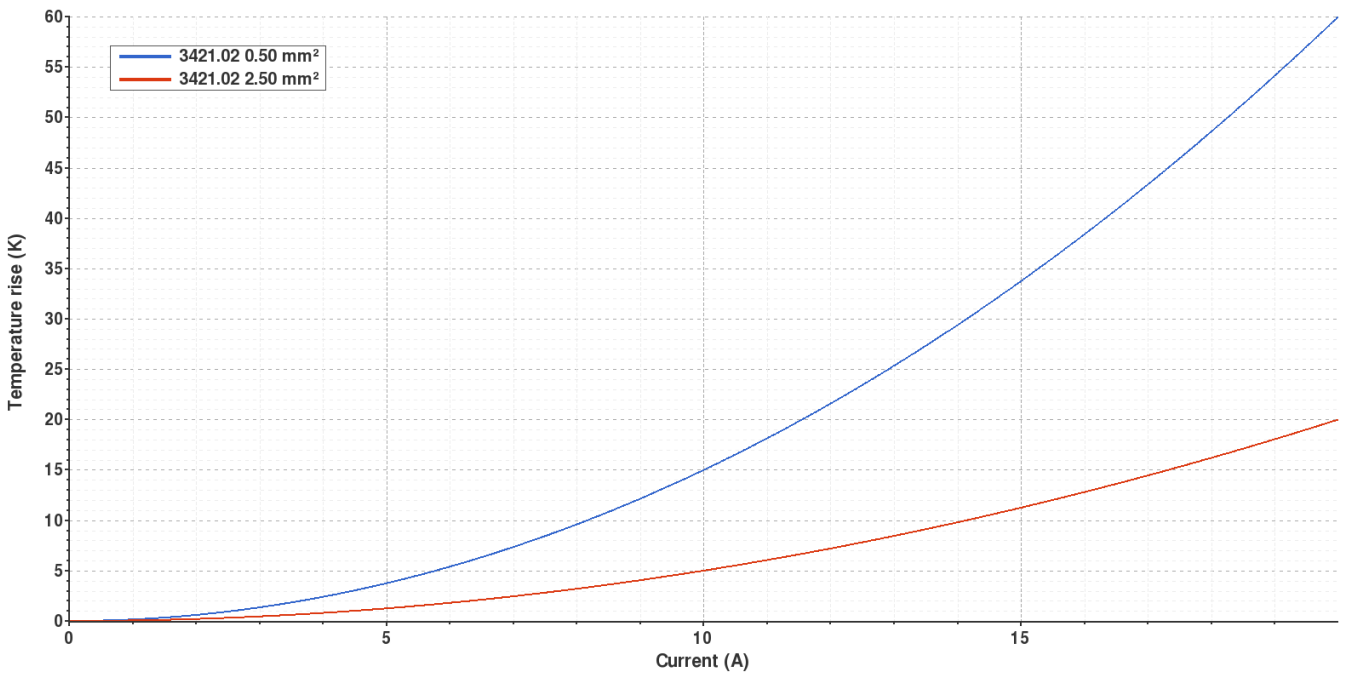

Valid for 3421.00 - M5



3421.**
RING TERMINALS · WITH INSULATION SUPPORT



Disclaimer

Data obtained from Escubedo Laboratory essays, using own methodology, cablings, equipment and original crimping tools, done in laboratory conditions and following the indicated standards, errors and omissions excepted. This document has no contractual meaning and it is publicised only for informative purposes. It can be changed without prior notice. The end customer has the sole responsibility to check these characteristics in its environment and with its own components, manufacturing methods and equipment. See also the full range product overview if available. For further information please visit our web site or contact us

Rev. Nr.	Concept	Date	Created/Revised	Approved
A3	Update de-rating curves - 3421.02	2018-07-12	Laboratory Dept.	E. Roura
A2	Update de-rating curves	2018-07-05	Laboratory Dept.	E. Roura
A1	Datasheet generated automatically [A1]	2018-06-29	Laboratory Dept.	E. Roura